

ULTRACHem[®] Series

A N S I D I M E N S I O N A L M A G D R I V E

UCP1516, UCP1516L, UCP1518, UCP1518L,
UCP3156, UCP326, UCP326H, & UCP436L


OPERATIONAL MANUAL

P/N 212184 R1

Record your Model and Serial Number here.

MODEL NUMBER _____

SERIAL NUMBER _____

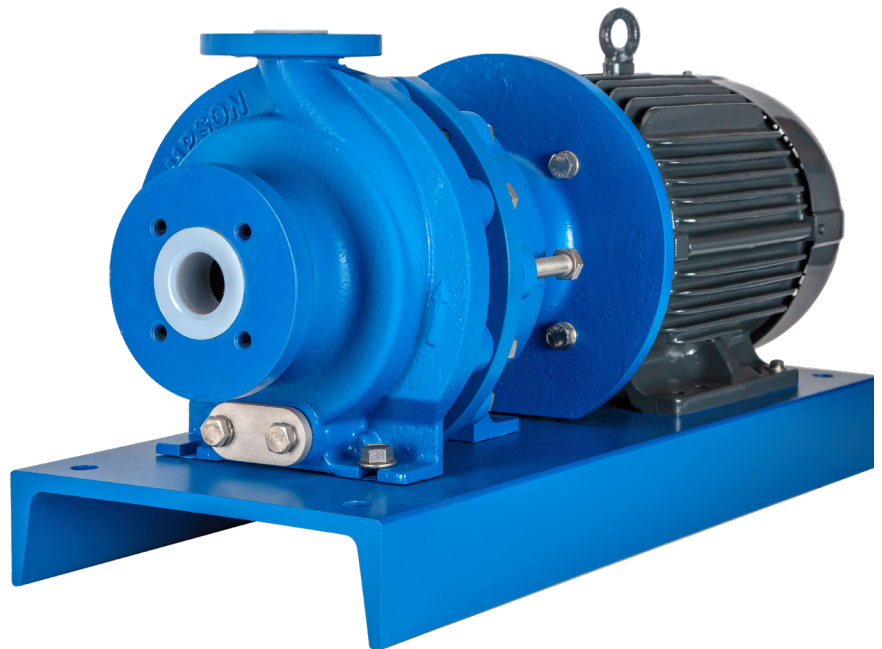

FINISH THOMPSON INC.



FINISH THOMPSON INC.

921 Greengarden Road • Erie, PA 16501-1591 U.S.A.
Ph 814-455-4478 • Fax 814-455-8518
Email fti@finishthompson.com • www.finishthompson.com

EU Declaration of Conformity



Finish Thompson Inc. hereby declares that the following machine(s) fully comply with the applicable health and safety requirements as specified by the EU Directives listed. The product may not be taken into service until it has been established that the drive motor for the centrifugal pump complies with the provisions of all relevant EU Directives. The complete product complies with the provisions of the EU Directive on machinery safety provided motors carry CE marking.

This declaration is valid provided that the devices are fully assembled and no modifications are made to these devices.

Type of Device:
Centrifugal Pumps

Models:

UC 1516/1516L/1518/1518L/2110/2110L/3110/3156/3158/326/326H/436/436L/438/4310H/6410
UCR 1516/1516L/1518/1518L/2110/2110L/3110/3156/3158/326/326H/436/436L/438/4310H/6410
UCP 1516/1516L/1518/1518L/3156/326/326H/436L

EU Directives:
Machinery Safety (2006/42/EC)

Applied Harmonized Standards:
EN ISO 12100:2010
EN 809:1998+A1:2009+AC:2010

Manufacturer: Finish Thompson Inc.
921 Greengarden Road
Erie, Pennsylvania 16501-1591 U.S.A

Signed,

Product Engineering Manager

31 December 2024

Person(s) Authorized to Compile Technical File: Finish Thompson GmbH
Otto-Hahn-Strasse 16
Maintal, D-63477 DEU Telephone:
49 (0)6181-90878-0

Conflict Minerals Compliance Statement

Section 1502 of the Dodd-Frank Wall Street Reform and Consumer Protection Act, along with the United States Securities and Exchange Commission have adopted the rule into law, requiring corporations listed on the United States stock exchange to report the use of “Conflict Minerals” in the sourcing and manufacturing of products.

The term “conflict minerals” is used to describe the minerals cassiterite, columbite-tantalite, gold, wolframite, and/or their derivatives, including tin, tantalum, and tungsten, originating from the Democratic Republic of Congo and the specified adjoining countries in Africa, known to support human rights violations and funding to rebel warlords.

As a privately held company, we are not required to report to the SEC, however, many of our customers are required to meet this obligation. To support our customers, we are committed to get the best available information from our suppliers on all products we sell, and to openly share that information with our customers.

Finish Thompson suppliers agree to abide by our FINISH THOMPSON INC SUPPLIER CODE OF CONDUCT (available on our website) which includes the following statement: “Responsible Sourcing of Minerals: Participants shall adopt a policy and exercise due diligence on the source and chain of custody of the tantalum, tin, tungsten, and gold in the products they manufacture to reasonably assure that they are sourced in a way consistent with the Organization for Economic Co-operation and Development (OECD) Guidance for Responsible Supply Chains of Minerals from Conflict- Affected and High-Risk Areas or an equivalent and recognized due diligence framework.” As of July 2024, over 75% of our supply chain has been contacted and supplied information regarding compliance to Section 1502 of the Dodd-Frank Wall Street Reform and Consumer Protection Act regarding “Conflict Minerals.” 7 of the 598 smelters identified by our supply chain have been identified as conflict smelters. As part of our due diligence process, we have reached out to those specific suppliers regarding the need to eliminate sourcing from them.

We will continue to work with our suppliers to identify any potential use of Conflict Minerals in our supply chain, and ensure the representations made in this compliance statement remain accurate. To that end, we reserve the right to amend this statement at any time based on subsequent developments or information.

Should you have any questions or concerns regarding this statement, please do not hesitate to contact us.

Orkun Demirag

Director of Purchasing
Finish Thompson

REACH Compliance Statement

Finish Thompson products are REACH compliant. Finish Thompson Inc. (FTI) does not produce substances of very high concern (SVHC). Finish Thompson is a downstream user of articles and relies on upstream suppliers for notification regarding substances registered with REACH. The substances present in articles produced by FTI do not meet the thresholds required for REACH registration.

Some FTI components may contain trace amounts of substances listed on the REACH Candidate list. To this end, normal hygiene practices are recommended to ensure safe handling of FTI products. After handling FTI products, wash hands with soap and water. When the product is no longer useful, dispose of the product in compliance with local regulations.

Neil Kruse

Engineering Manager

Finish Thompson



Table of Contents

Warranty Statement	6
Safety Precautions	6
UCP Pump Models.....	7
UCP Impeller Diameters.....	7
UCP Features	8
ULTRAChem Capabilities.....	8
Maximum Allowable Horsepower	8
Minimum Allowable Flow Rate.....	9
Unpacking and Inspection	9
Model Number and Serial Number	9
Installation	
Pumps with Motors	9
Pumps without Motors	10
Foundation	11
Baseplate	12
Piping	12
Electrical	13
Operation	
Pre-operation Inspection	13
Start-up and Operation.	13-14
Shutdown	14
Disassembly/Reassembly	
Disassembly of Pump End.....	14-15
Disassembly of Power End (Motor Side)	15
Examination.....	15-16
Replacing Wear Components.....	16
Shaft Support/Front Thrust Washer.....	16
Installation of Replacement Support/Front Thrust Washer	16
Impeller Thrust Ring Removal & Replacement.....	16
Rear Sealing Ring	17
Impeller Bushings.....	17
Impeller Replacement	18
Power End Reassembly.....	19
Pump End Reassembly.....	19
Troubleshooting	20
General Notes	
Important Notice	20
Chemical Reaction Disclaimer.....	20
Helpful Hints.....	20
Ordering Spare Parts.....	20
Exploded View Drawing	21
Parts List	22-27

WARRANTY

Finish Thompson, Inc (manufacturer) warrants this pump product to be free of defects in materials and workmanship for a period of two years from date of purchase by original purchaser. If a warranted defect, which is determined by manufacturer's inspection, occurs within this period, it will be repaired or replaced at the manufacturer's option, provided (1) the product is submitted with proof of purchase date and (2) transportation charges are prepaid to the manufacturer. Liability under this warranty is expressly limited to repairing or replacing the product or parts thereof and is in lieu of any other warranties, either expressed or implied. This warranty does apply only to normal wear of the product or components. This warranty does not apply to products or parts broken due to, in whole or in part, accident, overload, abuse, chemical attack, tampering, or alteration. The warranty does not apply to any other equipment used or purchased in combination with this product. The manufacturer accepts no responsibility for product damage or personal injuries sustained when the product is modified in any way. If this warranty does not apply, the purchaser shall bear all cost for labor, material and transportation.

Manufacturer shall not be liable for incidental or consequential damages including, but not limited to process down time, transportation costs, costs associated with replacement or substitution products, labor costs, product installation or removal costs, or loss of profit. In any and all events, manufacturer's liability shall not exceed the purchase price of the product and/or accessories.

Warranty Registration

Thank you for your purchase of this quality Finish Thompson product. Be sure to take a minute to register your pump at Finishthompson.com/warranty. Simply provide the model number, serial number and a few other pieces of information.

SAFETY PRECAUTIONS

-  **WARNING:** READ THIS MANUAL COMPLETELY BEFORE INSTALLING AND OPERATING THIS UNIT. FAILURE TO FOLLOW THESE PRECAUTIONS CAN RESULT IN SERIOUS INJURY OR DEATH.
-  **WARNING:** Magnetic force hazard. This pump should only be disassembled and assembled using the recommended procedures. The magnetic attraction is powerful enough to rapidly pull the motor end and the wet end together. ALWAYS use the jackscrews (item 14) to assemble/disassemble the pump. Do not place fingers between the mating surfaces of the motor and wet ends to avoid injuries. Keep the drive magnet and impeller assembly away from metal chips or particles.
-  **WARNING:** Magnetic Field Hazard. This pump contains powerful rare earth magnets. When the pump is disassembled (not connected to a motor) and the magnets are exposed, these magnets produce powerful magnetic fields. Individuals with cardiac pacemakers, implanted defibrillators, other electronic medical devices, metallic prosthetic heart valves, internal wound clips (from surgery), metallic prosthetic devices or sickle cell anemia must not handle or be in the proximity of the magnets contained inside the pump. Consult a health care provider for specific recommendations before working with this pump.
-  **WARNING:** Hot surfaces. This pump is capable of handling liquids with temperatures as high as 250° F. This may cause the outer areas of the pump to become hot as well and could cause burns.
-  **WARNING:** Check for leaks on a regular basis. If any leaks are found, the pump must be repaired immediately.
-  **WARNING:** Rotating Parts. This pump has components that rotate while in operation. Follow local safety standards for locking out the motor from the power supply during maintenance or service.
-  **WARNING:** Chemical Hazard. This pump is used for transferring many types of potentially dangerous chemicals. Always wear protective clothing, eye protection and follow standard safety procedures when handling corrosive or personally harmful materials. Proper procedures should be followed for draining and decontaminating the pump before disassembly and inspection of the pump. There may be small quantities of chemicals present during inspection.
-  **WARNING:** Never run pump at less than minimum flow or with the discharge valve closed. This could lead to pump failure.
-  **WARNING:** Never operate the pump without safety features installed.
-  **WARNING:** The pump and associated components are heavy. Failure to properly support the pump during lifting and movement could result in serious injury or damage to the pump and components.
-  **CAUTION:** Do not run the pump dry. This pump should never be started without liquid in the casing. This could damage the pump. The fluid being transferred by the pump lubricates the pump components. Even short periods of running the pump dry could damage the pump. It is recommended that run dry protection be used. Optional electronic power monitors are available to help protect against run dry.
-  **CAUTION:** The correct o-ring material must be chosen to ensure compatibility with the fluid being pumped. If the incorrect material is chosen, it can lead to swollen or degrading o-rings that allow leaking. O-ring material selection is the responsibility of the end user.
-  **CAUTION:** Never start or operate with a closed suction valve. Never operate with a closed discharge valve.
-  **CAUTION:** Always provide adequate NPSHa (net positive suction head available).

UCP Pump Models

Model Codes and Abbreviations

UCP	1516		B	E	C	C	A	V	P	600	18	B	01
Series	Size		Magnet Set	Flange	Coupling Type	Bushing	Shaft	O-ring	Thrust Ring	Impeller Diameter	Frame	Bump Ring	Motor
Series:	Pump Size:	UCP 1516/1516L = 1 1/2" suction x 1" discharge x 6" diameter impeller 1518/1518L = 1 1/2" suction x 1" discharge x 8" diameter impeller 3156 = 3" suction x 1.5" discharge x 6" diameter impeller 326/326H = 3" suction x 2" discharge x 6" diameter impeller 436L = 4" suction x 3" discharge x 6" diameter impeller											
Magnet set:	B = Maximum horsepower to 30 @ 3500 rpm (see chart)												
Flange:	E = ANSI 150# T = ANSI 300# I = ISO/DIN/PN40 N = None												
Coupling type:	C = Close coupled F = Bearing frame mounted												
Bushing:	S = Sintered silicon carbide C = Carbon D = Dri-Coat												
Shaft:	A = Alumina Caramic S = Sintered silicon carbide D = Dri-Coat												
O-ring:	T = FEP Encapsulated FKM V = FKM E = EPDM K = Kalrez S = Simriz												
Thrust ring:	P = Glass/Moly filled PTFE (not available on 1516L/1518L) S = Silicon Carbide												

Impeller diameter: (Impellers available in 1/8" increments)

Note: Kalrez® is a registered trademark of DuPont Performance Elastomers

Simriz® Perfluoroelastomer is a registered trademark of the Simrit® division of Freudenberg-NOK

UCP Impeller Diameters:

UC1516/1516L = 637 (6 3/8"); 625 (6 1/4"); 612 (6 1/8"); 600 (6"); 587 (5 7/8"); 575 (5 3/4"); 562 (5 5/8"); 550 (5 1/2"); 537 (5 3/8"); 525 (5 1/4"); 512 (5 1/8"); 500 (5"); 487 (4 7/8"); 475 (4 3/4"); 462 (4 5/8"); 450 (4 1/2"); 437 (4 3/8"); 425 (4 1/4"); 412 (4 1/8"); 400 (4")

UC1518/1518L = 825 (8-1/4"); 812 (8 1/8"); 800 (8"); 787 (7 7/8"); 775 (7 3/4"); 762 (7 5/8"); 750 (7 1/2"); 737 (7 3/8"); 725 (7 1/4"); 712 (7 1/8"); 700 (7"); 687 (6 7/8"); 675 (6 3/4"); 662 (6 5/8"); 650 (6 1/2"); 637 (6 3/8"); 625 (6 1/4"); 612 (6 1/8"); 600 (6")

UCR3156/326/326H/436L = 637 (63/8"); 625 (6 1/4"); 612 (6 1/8"); 600 (6"); 587 (5 7/8"); 575 (5 3/4"); 562 (5 5/8"); 550 (5 1/2"); 537 (5 3/8"); 525 (5 1/4"); 512 (5 1/8"); 500 (5"); 487 (4 7/8"); 475 (4 3/4"); 462 (4 5/8"); 450 (4 1/2"); 437 (4 3/8"); 425 (4 1/4")

Motor frame:

14 = 143-145TC
 18 = 182-184TC
 21 = 213-215TC
 25 = 254-256TC
 29 = 284-286TSC
 90 = 90 frame w/ B14 flange
 95 = 90 frame w/ B5 flange
 10 = 100/112 frame w/ B14 flange
 13 = 132 frame w/ B5 flange
 15 = 100/112 frame w/ B5 flange
 16 = 160 frame w/ B5 flange
 FO = Frame mounted, flood oil
 FB = Frame mounted, regreasable bearings

Bump Ring: B = Non-sparking Bronze

If the bronze bump ring is required for hazardous locations (HazLoc), add the letter "B" after the two digit motor frame code (14B for example).

UCP Features

The Finish Thompson UCP is a sealless, magnetically driven, ANSI dimensional, ETFE lined, chemical pump. It has been specifically designed for corrosive chemical applications in a wide range of industrial services.

The UCP features a closed impeller, suction straightening vanes, balanced axial thrust with a rear sealing ring, balance holes and balanced radial thrust due to the modified concentric volute shape.

The UCP uses standard alumina ceramic shaft, silicon carbide housing thrust ring with glass/moly-filled PTFE impeller thrust ring and carbon bushings. All metallic components are steel or cast ductile iron.

High strength, rare earth neodymium boron iron magnets are used for maximum power and reliability. Finish Thompson's patented magnetic technology ensures an extraordinarily strong, secure coupling between the motor and pump.

The barrier consists of a precision molded glass filled PP liner with an external carbon fiber & epoxy resin shell for superior mechanical strength and elimination of eddy currents in the magnetic coupling. The sealless design virtually eliminates maintenance and environmental emissions.

The Easy Set drive feature makes installation of the outer drive quick and easy. It eliminates the need for measuring and ensures that the inner and outer magnets are perfectly aligned to transmit maximum power.

The UCP has drive hubs and motor adapters for a complete range of NEMA and IEC motor frames. The suction and discharge flanges are drilled for both ANSI and ISO.

These features combine to provide our customers with a pump that offers a broad operating range with outstanding reliability due to minimum hydraulic loads and premium materials of construction.

ULTRAChem Capabilities

Maximum Working Pressure:	300 psi (21 bar)
Maximum Temperature:	180°F (82°C)
Minimum Temperature:	-20°F (-29°C)
Maximum Flow:	480 USgpm (109 m ³ /hr)
Maximum Head:	330 ft (101 m)
Maximum Viscosity:	200 cP
Maximum Noise Level:	80 dBA (pump only)
Solids:	Maximum particle size is 50 microns for slurries and 1/64" (.4 mm) for infrequent particles. Maximum hardness is 80 HS. Maximum concentration is 5% by weight. If solids are being pumped, it is recommended the pump have the silicon carbide bushings and thrust washer.

Maximum Allowable Horsepower

Do not exceed the maximum horsepower rating for the pump coupling. Refer to the chart below. Use the first six or seven characters from the model number listed on the label found on the motor adapter.

Magnet Set	60 Hz (3500 RPM)		50 Hz (2900 RPM)		30 Hz (1750 RPM)		25Hz (1450 RPM)	
	HP	kW	HP	kW	HP	kW	HP	kW
B	30	18.5	25	18.5	15	11	10	7.5

Minimum Allowable Flow Rate

Do not allow the flow rate to drop below the minimum flow rate listed in the chart below. Use the first five or six characters from the model number listed on label found on the motor adapter.

Pump Model	Minimum gpm @ 3500 RPM (60 Hz)	Minimum m ³ /hr @ 2900 RPM (50 Hz)	Minimum gpm @ 1750 RPM (60 Hz)	Minimum m ³ /hr @ 1450 RPM (50 Hz)
UCP1516	5	1.1	3	0.75
UCP1516L/1518L	1	0.3	1	0.3
UCP1518	5	1.1	3	0.75
UCP3156/326/326H/436L	5	1.1	3	0.75


Unpacking and Inspection

Unpack the pump and examine for any signs of shipping damage. If damage is detected, save the packaging and notify the carrier immediately.

To install the pump, follow the installation instructions provided.



WARNING: The pump and associated components are heavy. Failure to properly support the pump during lifting and movement could result in serious injury or damage to the pump and components. (See figure A)

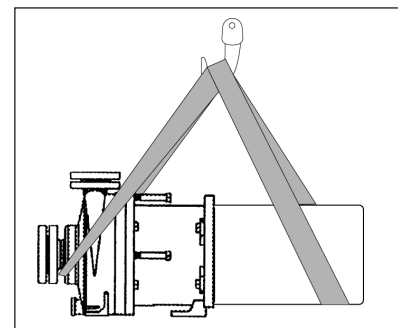

Model Number and Serial Number

Record the model number and serial number for future reference. Use the location provided on the front cover of this manual.

This is important information when ordering replacement parts or when technical assistance is required. The model and serial number are found on a label located on the motor adapter.

Installation

To install a motor to a pump end, see section Assembly of Pumps without Motors, and then proceed to section Foundation.

Note: A hydrostatic test was performed prior to shipment. It is normal for a small amount of water to be retained inside the pump.

Vertical Operation

UCP Series pumps can be installed in a vertical position (either pump facing up or pump facing down) but the motor **MUST** be an IEC 100 frame motor or larger. IEC motors have a bolt in the motor shaft that prevents the outer drive from moving. IEC 90 frame and smaller motors contain a wavy washer on both ends of the motor shaft that can allow the outer drive to potentially rub. The pump must be securely fastened to a solid material capable of absorbing any vibration that the pump will produce.

Pumps with Motors:

Proceed to Foundation Section.

Pumps without Motors:

1. Carefully place the motor on a suitable, level work surface (a nonmagnetic surface is preferred). Make sure the work surface is free of metal chips or particles. Ensure you have the correct UCP outer drive which are black in color.
2. Coat the motor shaft with anti-seize paste.

⚠ Magnetic Force Hazard. This pump should only be disassembled and assembled using the recommended procedures. The magnetic attraction is powerful enough to rapidly pull the motor end and the wet end together. ALWAYS use the jackscrews (item 14) to assemble/disassemble the pump. Do not place fingers between the mating surfaces of the motor and wet ends to avoid injuries. Keep the drive magnet and impeller assembly away from metal chips or particles.

⚠ CAUTION: Keep the drive hub away from the open end of the motor adapter and barrier. Strong magnetic attraction could allow the drive hub to enter the motor adapter resulting in injury or damage.

3. For **160 B5 IEC** frames only:
 - A. Place the vapor protection ring into the groove on the motor adapter flange (Item 10) Use petroleum jelly or similar substance to help keep the o-ring in place.
 - B. Place the motor adapter flange into position on the motor face using supplied hardware (item 30 & 31). Torque to 90 ft-lbs (122 N-m).
 - C. Continue to step 5.
4. For **NEMA 143-145TC, 182-184TC, 213-215TC, 254-256TC, 284-286TSC** motor frames:
 - A. Slide shaft adapter onto motor shaft until end of shaft is firmly against retaining ring. See figure 1. The shaft adapter is held to a tight tolerance with motor shaft. It may be necessary to tap the shaft adapter into position using a dead blow hammer or heat it with an oven/induction heater to around 180° F (82° C)
 - B. Using a 3/16" bit and torque wrench, tighten both setscrews to 228 in-lbs (25.8 N-m).
5. For **90, 132, & 160 IEC** motor frames:
 - A. Slide the shaft adapter onto motor shaft until end of shaft is firmly against retaining ring. The shaft adapter is held to a tight tolerance with the motor shaft. It may be necessary to tap the shaft adapter into position using a dead blow hammer or heat it with an oven/induction heater to around 180° F (82° C).
 - B. Install the appropriate hex bolt, drive washer, and lock washer (Items 20, 21 & 22) into the end of the motor shaft and then tighten to the following torque settings:
 - i. 90 frame: 120 in-lbs (13.7 N-m)
 - ii. 132 frame: 35 ft-lbs (47.5 N-m)
 - iii. 160 frame: 90 ft-lbs (122 N-m)
6. For **100/112 IEC motor** frames:
 - A. Slide the shaft adapter onto motor shaft until end of shaft is firmly against retaining ring. The shaft adapter is held to a tight tolerance with motor shaft. It may be necessary to tap the shaft adapter into position using a dead blow hammer.
 - B. Install bolt and drive washer (Items 18 & 20), tapered side out, and torque to 250 in-lbs.
7. Using a 22mm socket, unbolt the wet end (Items 1 through 10) from the motor adapter (Item 12) by removing the (4) M14 hex head cap screws (Item 27). Extend the (2) jackscrews (Item 29) using a 22mm socket, turn the jackscrews clockwise until they are fully extended. See figure 2.

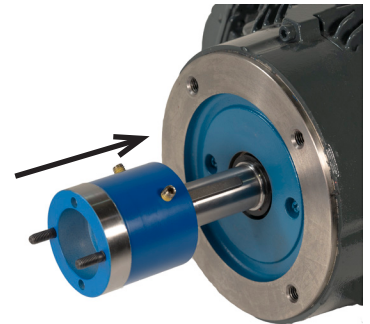


figure 1a

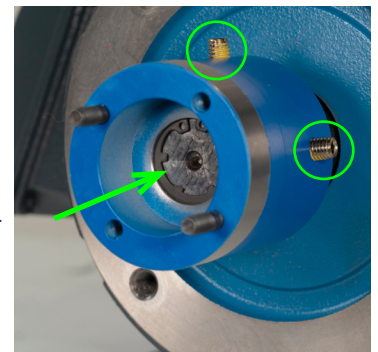


figure 1b



figure 2

8. Slide the motor adapter over the shaft adapter and secure the motor face using hex head bolts (Items 30 & 31) and lock washers. See figure 3.

Torque the hex head bolts to the following values:

- A. 145TC 3/8-16 bolt: 15 ft-lbs (20.3 N-m)
- B. 182/184TC, 213/215TC, 254/256TC, 284-286TSC 1/2-13 bolt: 75 ft-lbs (102 N-m)
- C. IEC 90 & 100/112 M8-1.25 bolt: 120 in-lbs (13.7 N-m)
- D. IEC 132 M12-1.75 bolt: 35 ft-lbs (47.5 N-m)
- E. IEC 160 1/2-13 bolt: 75 ft-lbs (102 N-m)

Note: 1/2" bolts are for motor adapter (item 12) to motor adapter flange (item 14) for this motor size only.

9. Place a thin coat of anti-seize paste on the magnet drive hub on the unpainted fit diameter. See figure 4.
10. Using the threaded studs in the shaft adapter as a guide, slide the magnet hub onto the shaft adapter. The magnet hub and shaft adapter are held in close tolerance to one another. Use two M8-1.25 hex head bolts to draw the hub onto the adapter as necessary. See figure 5. Avoid hitting the outer edge of the magnet hub as impact can damage the glue bond between the magnet and the hub.
11. Secure the magnet hub to the shaft adapter with the two M8 hex head bolts and lock washers as well as the two M8 hex nuts with lock washers. Torque the bolts and nuts to 120 in-lbs (13.7 N-m).

Note: Use supplied cardboard tube to help protect outer drive magnets from damage from tools. Be sure to remove tube after drive is securely attached. Save tube for potential future repairs. If your pump did not ship with cardboard tube, consult spare parts list for ordering information.

Pump to Motor Assembly

1. Turn the two jackscrews clockwise until the heads touch the motor adapter.
2. Carefully slide the wet end towards the motor adapter until it touches the jack screws. There will be some magnetic attraction. See figure 6.
3. Slowly and evenly, turn the jackscrews counterclockwise to allow the wet end to slowly slide into the motor adapter. When the jackscrews are fully retracted, lift the wet end slightly and slide it onto the motor adapter's locating flange, being careful not to pinch or cut the vapor protection o-ring.
4. Bolt the wet end to the motor adapter by re-installing the (4) M14 hex head cap screws and torque evenly to 75 ft-lbs (102 N-m).

Foundation

1. The foundation that the pump will be sitting on should be strong enough to support the pump as well as absorb any vibration that the pump will produce. A concrete platform should be acceptable. Bolts embedded in the concrete can be placed by using a template or drawing. See figure 7. The use of a pipe sleeve larger than the bolt will compensate for base movement for final bolt location.
2. You must allow a gap no greater than 1 1/2 inches between the base and foundation for grouting.

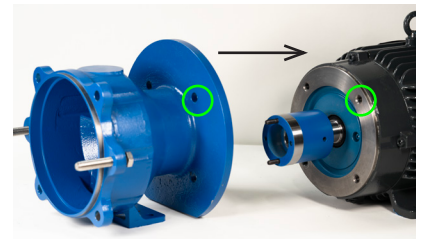


figure 3

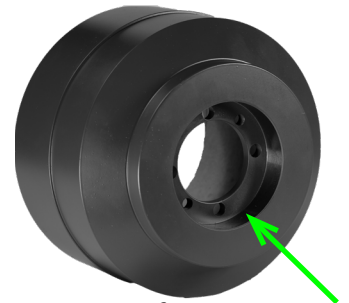


figure 4



figure 5

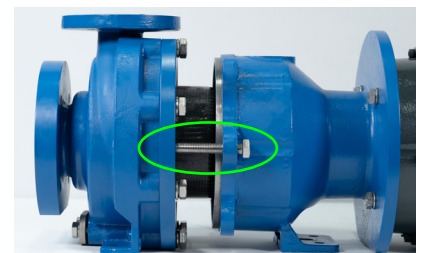


figure 6

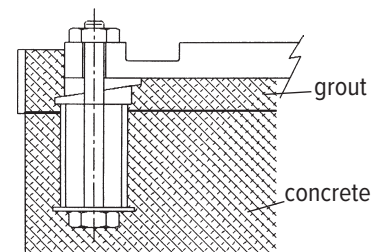


figure 7

Base plate

1. The base plate of the UCP must be placed on the foundation using two sets of wedges or shims. These shims should be placed on each side of the foundation bolts. Provide enough clearance for proper grouting.
2. Remove any water or other debris from the anchor bolt holes prior to grouting.
3. Carefully lower the base plate onto the foundation bolts.
4. Level the base plate to within 1/8-inch over the length and 1/16-inch over the width. This can be done by adjusting the wedges.
5. Hand tighten the bolts.

Grout the base plate

1. Ensure that the area that is to be grouted is clean. Follow instructions from the grout manufacturer.
2. Erect a dam around the foundation. Insure that the foundation is thoroughly wetted.
3. Pour grout in the dam and completely fill under and around the base plate to the level of the dam. Make sure that any air bubbles are removed as it is poured. It is recommended that non-shrinking grout be used.
4. Permit the grout to set at least 48 hours.
5. Tighten the foundation bolts.

⚠ CAUTION: Do not operate the pump until it is securely fastened!

Piping

1. The pump should be installed as near to the suction source as possible.
2. It is recommended that pipes are supported as close as possible to the pump and all flanges line up. This will minimize any pipe strain.
3. The suction side of the pump should be as straight and short as possible to minimize pipe friction or a length at least ten times the inlet diameter should follow any elbows.
4. The suction or inlet line should be at least as large as the suction inlet port or one pipe size larger so that it does not affect the NPSHa. Do not reduce the suction line size.
5. The suction line should not have any high spots. This can create air pockets. The suction piping should be level or slope slightly upward to the pump. See figure 8.
6. The NPSH available to the pump must be greater than the NPSH required. Filters, strainers, and any other fittings in the suction line will lower the NPSH available and should be calculated into the application.
7. A check valve and a control valve (if used) or isolation valve should be installed on the discharge line. The control valve is used for regulating system flow. An isolation valve is used to make the pump accessible for maintenance. It is recommended that the control or isolation valve be closed prior to stopping or starting the pump. The check valve is installed to protect the pump against water hammer damage. These recommendations are particularly important when the static discharge head is high.
8. It is advisable to install a flush system in the piping to allow the pump to be flushed before the pump is removed from service.
9. When connecting piping to the pump suction and discharge flanges, if lock washers are used, install under the head of the bolt. See figure 9.

figure 8


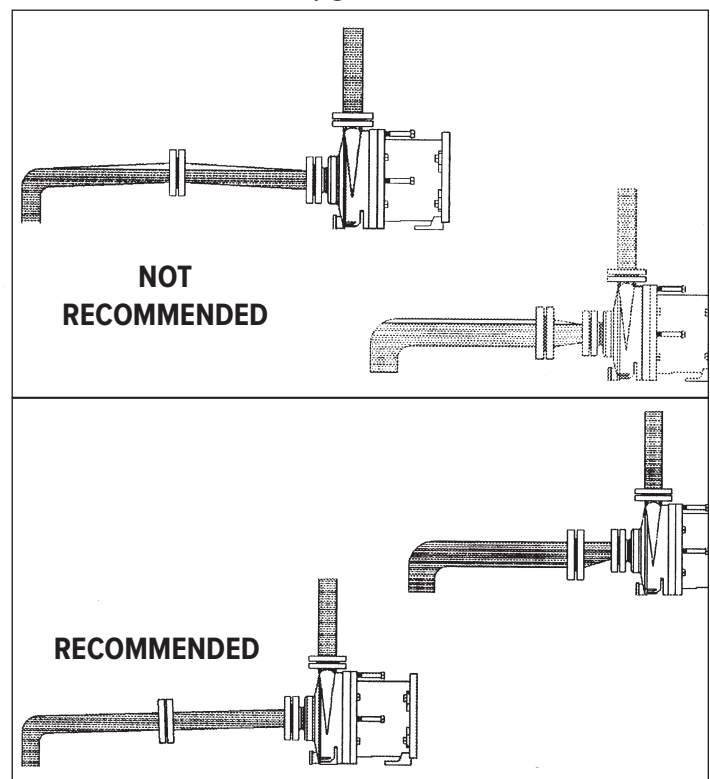


figure 9

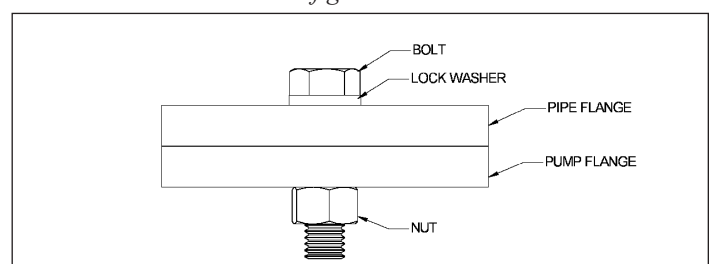

Motor/Electrical

Only qualified personnel trained in the safe installation and operation of this equipment should install the motor. Install the motor according to National Electric Code, NEMA MG-2, IEC standards requirements and/or applicable local electrical codes. The voltage and frequency variations of the power supply should never exceed the limits established in the applicable standard. Prior to connecting to the power line, check nameplate voltage, rotation connection and ensure proper grounding. Sufficient ventilation area should be provided to insure proper operation and cooling of the motor. The motor must be installed with a suitable overload protection circuit. For three phase motors it is recommended to install a phase failure protection device. Download the motor manual from the specific motor manufacturers' website for additional information concerning motor installation, safety and maintenance instructions.

Wire the motor for clockwise rotation when facing the fan end of the motor.



CAUTION: Do not operate the pump to check rotation until the pump is full of liquid or damage may occur even if the motor is "bumped" to check motor rotation direction.

Check all electrical connections with the wiring diagram on the motor. Make sure the voltage, frequency, phase and amp draw comply with the supply circuit.

If utilized, verify that power monitors or variable frequency drives have been properly installed according to the manufacturer's instructions.

Operation

Pre-Operation Inspection

Prior to the first operation of the pump, perform the following inspections:



WARNING: Lock out power to the driver to prevent accidental motor start-up and physical injury.

1. Insert a screwdriver through the fan cover and rotate the fan. It should move without restrictions.
2. Verify that all flange and hold down bolts are tightened.

Start-up and Operation

1. This pump must be filled from a flooded suction tank (gravity) or primed with liquid from an outside source. The ULTRACHem is not self-priming.
2. Ensure that the pump is full of liquid and the inlet (suction) valve is open.
3. Open the discharge valve completely and then close it so that there is no trapped air in the suction and discharge line.
4. After the pump is full of liquid, check that the rotation of the motor/ pump is in the correct direction. This can be achieved by jogging the motor for approximately 1/2 second. The motor rotation can be observed from the fan end. Correct rotation when viewed from the fan end is clockwise. Rotation arrows on clamp ring and housing show proper rotation direction.
Note: A pump running backwards will pump but at a greatly reduced flow and pressure.
5. Turn the pump on. Slowly open the discharge valve. Check pump for proper flow and pressure, and that pump runs without excessive noise or vibration.
6. Keep the suction valve in the fully open position. Never use the suction valve to regulate the flow rate. Use the discharge valve only.
Note: It is not necessary to jog the motor or adjust the valves on subsequent pump starts provided that the pump and piping remain full of liquid.



CAUTION: Do not run the pump dry. This could damage the pump. The fluid being transferred by the pump lubricates the pump. Even short periods of running the pump dry could damage the pump. It is recommended that a run dry protection device be used.



CAUTION: Do not dead head the pump for an extended period of time. Running the pump at zero flow will cause any liquid inside the pump to elevate rapidly in temperature. This will continue until the boiling point of the liquid is reached. The liquids will flash to vapor, causing the pump to run dry, and destroy the pump. Run dry protection in the form of a power monitor is recommended.



CAUTION: Cavitation for an extended period of time can cause pitting and damage on the pump components. Make certain NPSHa is greater than pump NPSHr.

CAUTION: Water hammer. Rapid changes in the fluid's velocity can cause large, sudden pressure surges. These pressure surges can damage the pump, plumbing and instrumentation. Common causes are rapidly closing valves. Check valves on the suction can also cause water hammer if the liquid has time to reverse direction before the valve closes.

Shutdown

Use the following procedures to shut the pump down.

1. Slowly close the discharge valve .
2. Shut off the motor.
3. Close the suction valve.

Disassembly/Reassembly

Disassembly - Pump End

WARNING: Rotating Parts. This pump has components that rotate while in operation. Follow local safety standards for locking out the motor from the power supply during maintenance or service.

WARNING: Chemical Hazard. This pump is used for transferring many types of potentially dangerous chemicals. Always wear protective clothing, eye protection and follow standard safety procedures when handling corrosive or personally harmful materials. Proper procedures should be followed for draining and decontaminating the pump before disassembly and inspection of the pump. There may be small quantities of chemicals present during inspection.

WARNING: The pump must be thoroughly flushed of any hazardous materials and all internal pressure relieved prior to opening the pump.

WARNING: Magnetic force hazard. This pump should only be disassembled and assembled using the recommended procedures. The magnetic attraction is powerful enough to rapidly pull the motor end and the wet end together. ALWAYS use the jackscrews (item 29) to assemble/disassemble the pump. Do not place fingers between the mating surfaces of the motor and wet ends to avoid injuries. Keep the drive magnet and impeller assembly away from metal chips or particles.

1. Stop the pump, lock out the motor starter, close all the valves that are connected to the pump, and drain/decontaminate the pump. The ULTRACem is supplied with a casing drain to help drain and decontaminate the pump. If the drain cap has been removed to drain/decontaminate the pump, reinstall the cap (item 2) and use a new gasket (item 2A). Torque the two cap bolts (M12) (item 16) to 35 ft-lbs (47.5 N-m).
2. Allow the pump to reach ambient temperatures prior to performing maintenance.
3. Remove the mounting bolts that attach the motor to the base, if any. Using a 22mm socket, remove the (4) M14 bolts (item 30) that secure the motor adapter (item 12) to the clamp ring (item 10). See figure 10.
4. Separate the magnetic coupling between the drive end and the pump end by using the (2) jackscrews (item 29). Using a 22mm socket turn the jackscrews clockwise. Be sure to turn the jackscrews evenly. Turn the jackscrews until they are fully extended. See figure 11.

CAUTION: After removal of the drive end, the jackscrews should be left fully engaged in the adapter to prevent accidental attraction of the magnetic coupling.
5. Using a 22mm socket, remove the (8) M14 hex head bolts (item 18) that connect the clamp ring to the casing (item 1). See figure 12.
6. Remove the clamp ring from the back of the barrier assembly (item 8).
7. Place the casing/barrier assembly on a table with the suction flange of the casing facing down. Carefully remove the barrier assembly from the casing. When pulling the barrier assembly out of the casing, the shaft and the impeller will normally be left in the casing. Occasionally the shaft will stick in the barrier. If this happens, make sure that the shaft does not drop out when the barrier assembly is removed or damage may result.



figure 10

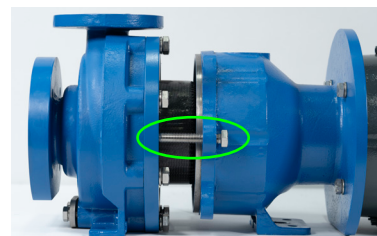


figure 11

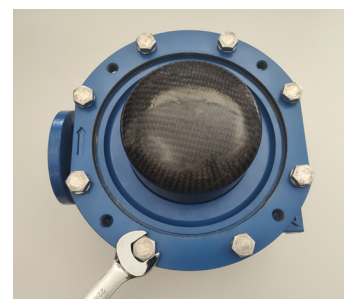


figure 12

- Remove the impeller assembly and the shaft from the casing. See figure 13.

⚠ CAUTION: The shaft and impeller can be damaged if dropped.



figure 13

Disassembly - Power End (motor side)

⚠ WARNING: This pump should only be disassembled and assembled using the recommended procedures. The magnetic attraction is powerful enough to rapidly pull the motor end and the wet end together. ALWAYS use the jackscrews (item 29) to assemble/disassemble the pump. Do not place fingers between the mating surfaces of the motor and wet ends to avoid injuries. Keep the drive magnet and impeller assembly away from metal chips or particles.

- Remove the two M8 hex nuts and lock washers (Items 24 & 26) & M8 hex head bolts and lock washers (Items 25 & 26). Pull the magnet drive hub (Item 11A) away from the shaft adapter (Item 11B). If the magnet drive hub is difficult to remove, you can thread (2) M8 hex head bolts (item 26) into the extra set of holes to use as jackscrews to pry it off. Make sure to apply equal turns to the bolts to pull the magnet drive hub off evenly. See figure 14.

Note: A cardboard tube is available to help protect the outer drive magnets from damage. If you do not have one of these tubes, please consult the spare parts list for ordering information.

- Remove the four motor adapter bolts and lock washers (items 30 & 31). Pull the motor adapter (Item 12) off the motor. See figure 15.
For IEC 160 frame, remove the motor adapter from the motor adapter flange (Item 14).
- Remove the two set screws for NEMA frames or shaft bolt for IEC frames. See figure 16.
- If replacing the motor for an IEC 160 frame, remove the four motor adapter flange bolts to remove the motor adapter flange.



figure 14



figure 15

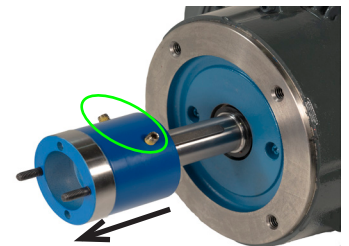


figure 16

Examination

The first scheduled inspection should take place after the first three months or approximately after 2000 hours of run time. This is to insure that there is no damage from any solids, particulate, cavitation or run dry. Reinspect after six to twelve months depending on the results of the initial inspection.

Note: All pumps should be checked for leaks on a regular basis. If any leaks are detected, the pump should be repaired immediately.

Note: A new o-ring (item 7) will be required after pump inspection. If the drain cap is removed, replace the gasket (item 2A)

- Inspect the bushings (items 5A) - The silicon carbide parts will not wear under normal operation. Polishing on a silicon carbide surface is a normal occurrence and usually does not require replacement. Check for signs of melting around the perimeter of the bushings. Make sure that the spiral groove on the bushing ID is not plugged. Check for chips or cracks on the rear face. Check bushings for wear (see figure 17). If the bushings appear worn, follow the steps listed in the section "Replacing Wear Components, Impeller Bushings."
- Check for cracks or excessive wear on the shaft (item 6), impeller thrust ring (item 4A) and rear sealing ring (item 8A). Replace if cracked or excessively worn. See figure 18.

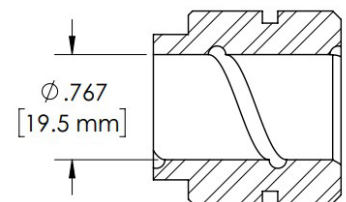


figure 17

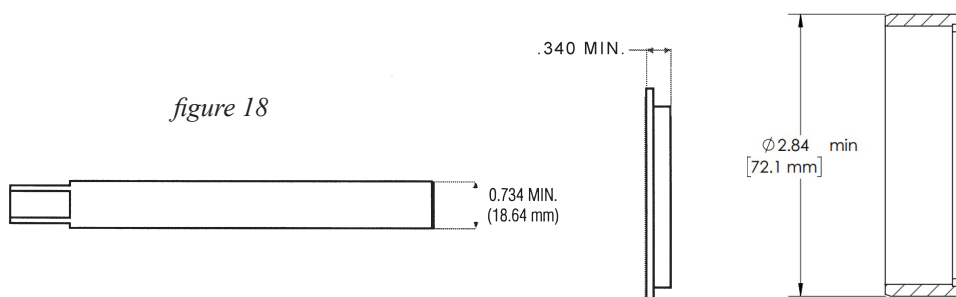


figure 18

3. Check for signs of deformation or melting in the shaft support (item 3) and the barrier liner where the pump shaft is positioned. Dry running the pump during its initial start-up or operation can cause heat-related damage to these components.
4. Inspect the casing liner. It is important that there are no abrasions or cuts deeper than .04 inch in the lining. These cracks may occur if the lining is corroded or abraded. Liner damage can usually be detected visually. Some hairline cracks require an electrostatic discharge tester to detect.
5. Locate the impeller vanes (impeller is item 4). Make certain that there are no obstructions. If there is an obstruction in any of the flow paths, then an imbalance may cause excessive wear on the pump shaft and impeller bushings.
6. Check the impeller drive assembly (item 5) for cracks or grooves larger than .02 inch. If a fluid comes in direct contact with the magnets, the magnets may swell, cause rubbing, and damage the barrier assembly (item 8).
7. Inspect the barrier assembly for signs of abrasion. Replace the barrier assembly if there are grooves or scratches that are deeper than .04 inch.

Replacing Wear Components

Use the following procedures to replace any wear components that are excessively worn, cracked or broken.

Shaft Support/Front Thrust Washer Removal

1. Remove the casing (item 1) from the base plate and piping.
2. Place the casing in an arbor press with ETFE lining side down.
3. Place arbor on the nose of the front shaft support (item 3) and carefully press the front shaft support out of casing. See figure 19.

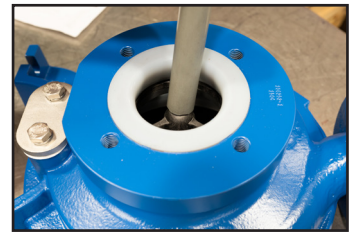


figure 19

Installation of Replacement Support/Front Thrust Washer

1. Place the casing in an arbor press with the suction flange down.
2. Put front thrust washer into new shaft support. Align the slots in the thrust ring with the tabs on the front shaft support.
3. Position the front shaft support in the bore of the casing suction and align the flats on the front shaft support with the flats in the housing.
4. Press evenly on the face of the plastic shaft support with a soft-faced arbor until the front shaft support is fully seated in the bore.

Impeller Thrust Ring

The impeller thrust ring is located in the front of the impeller shroud.

Removal

1. The impeller thrust ring (item 4A) is removed by grabbing the top of the ring with pliers and pulling with a twisting motion. Be careful not to damage the bore or face of the front impeller shroud. See figure 20.

Note: A new impeller thrust ring will be required after removal.



figure 20

Replacement

1. Place the impeller and impeller drive assembly (items 4, 4A, 4B, 5, 5A, 5B) on a table with the suction side facing up.
2. Position the replacement impeller thrust ring in the bore of the front shroud with the snap fit ridge towards the bottom of the bore. See figure 21. Align the anti-rotation flat on the impeller thrust ring with the flat in the impeller shroud.
3. Place the impeller and impeller drive assembly in an arbor press. Using a soft faced arbor, gently press the impeller thrust ring into place.

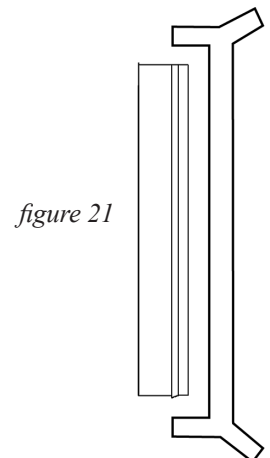


figure 21

Rear Sealing Ring

The rear sealing ring (item 8A) is located in the rear bore of the barrier assembly (item 8).

Removal

1. Place barrier (item 8) on a table with open side facing up.
2. Remove rear sealing ring by cutting it with a #18 straight edge X-Acto knife or similar blade & gently cut through the ring. Once cut, pry open and remove the ring from the barrier inner shaft boss. See figure 22.
3. Using a rotary cutting tool, carefully cut the sealing ring retainer and sealing ring retainer lock so they can be removed. Be careful not to damage the barrier liner.
4. Remove the old parts and clean any debris from the barrier.

Replacement

1. Place barrier (item 8) in an arbor press with the open side facing up.
2. Place the rear sealing ring on the inner shaft boss of the barrier assembly, align the two tabs so they will fit in between the ribs located in the bottom of the barrier. See figure 23.
3. Place sealing ring retainer onto barrier liner by aligning the three lobes. Press down until fully seated. Rotate sealing ring retainer until the three lobes line up with the lobes in the barrier. If the retainer does not easily rotate press down again to ensure it is fully seated. It should rotate freely.
4. Place sealing ring retainer lock on by aligning the three tabs with the lobes in the barrier.
5. Gently press the ring into place evenly using an arbor press and a 2.25" (57.2 mm) diameter tool.
Note: this is the minimum inner diameter for the tool to fit over the rear shaft boss.
See figures 24, 25, 26.
6. Sealing ring retainer lock is fully seated when it "snaps" into the machined groove on the sealing ring retainer. The top of the locking ring and the top on the retainer should be even. See figure 27.




figure 22



figure 23



figure 24



figure 25



figure 26




figure 27

Impeller Bushings

Removal

1. Remove the impeller (item 4) according to the steps listed in the section "Impeller Assembly, Removal".
2. Place the impeller drive assembly (items 5, 5A, 5B) on an arbor press with the front of the impeller drive facing up. Ensure there is at least 1-1/2" under the bushing to allow its complete removal, put something soft down underneath the Impeller drive to catch the bushing.
3. Insert bushing removal tool (P/N 211499) through the rear bushing bore until it clears the 1st bushing. When the lip of the tool is between bushings, expand tool by holding flats with a 5/8" wrench and turning 7/32" hex key clockwise until flush. Once tool is fully expanded, bushing can be pressed out. Some force will be required to shear the PTFE bushing retainer ring. See figure 28-29.
4. Once one bushing is removed, remove bushing removal tool and flip drive over.
5. Expand the bushing removal tool, or use a plastic arbor approximately 1" in diameter to remove 2nd bushing. Some force will be required to shear the PTFE bushing retainer ring.
6. Check the impeller bore for signs of plastic melting or fretting wear.

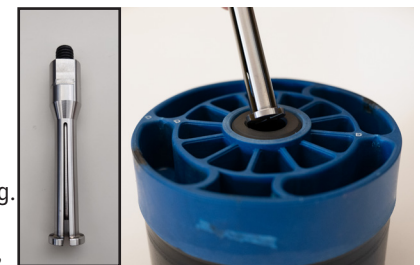


figure 28



figure 29

Replacement

1. Place drive flat onto either the top or bottom surface.
2. Install new bushing retaining rings by opening them slightly and installing in the groove on the bushing. The wide end of the ring should face away from the square of the bushing. See figure 30.
3. Line up the square on the bushing with the square of the impeller drive
4. Using a plastic arbor approximately 1" in diameter, press bushing until it is fully seated. See figure 31.
5. Flip drive over and repeat for the other bushing.
6. Check alignment by placing drive over shaft to ensure no binding occurs. If binding occurs, remove bushings, replace bushing retainer rings, and reinstall bushing.



figure 30



figure 31

Impeller Replacement

1. Make sure the bushing and spacer are properly inserted in the impeller drive. Bushing nose piece will stick out about 1/4" from the impeller drive. See figure 32.
2. Place the drive hub assembly in an arbor press with the kidney shaped slots facing up. See figure 33 below.
3. Align the snap-fit prongs from the impeller vanes with the larger slots on the drive. See figure 34 below.



figure 32

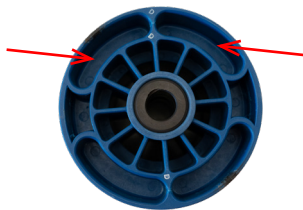


figure 33




figure 34

4. Complete installation by pressing the impeller assembly into the impeller drive with an appropriate size arbor. Be sure the arbor does not touch the impeller thrust ring. Use an arbor with a larger diameter than the eye of the impeller. See figure 35. Press until the back side of the impeller rear shroud is flush with the front face of the drive hub assembly. See figures 36 through 38 below.



figure 35

5. Impeller can now be reinstalled back into the pump.



figure 36

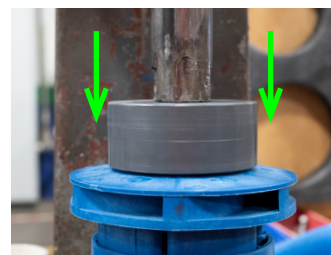


figure 37




figure 38

Power End Reassembly

See section Assembly of Pumps without Motors, steps 1-7.

Pump End Reassembly

1. Take the pump casing (item 1) and lay it suction side down on a clean flat surface. See figure 39.
2. Carefully place the impeller and impeller drive assembly (items 4, 4A, 4B, 5, 5A, 5B) inside the pump casing with the impeller facing down. See figure 40.

⚠ CAUTION: Do not use steel/iron tools near the magnets. These tools are attracted to the strong magnetic force and could damage them upon impact.

3. Install a new o-ring (item 7) into the pump casing (item 1). See figure 41.
4. Install the shaft (item 6) into the barrier assembly (item 8). Align the square hole in the barrier assembly with the square end of the shaft and press shaft in straight until fully seated.
5. Insert the shaft's rounded end through the center of the impeller assembly and into the round hole in the shaft support (item 3) in the casing. Press down on the barrier assembly until it is fully seated. See figure 42.



figure 39

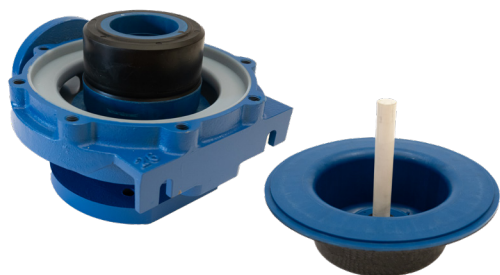


figure 40



figure 41



figure 42

6. Place the rounded edge of the clamp ring (Item 10) over the barrier assembly and position on the rear face of the casing. The flat and rotation arrow should be at the discharge side of the housing. Attach the clamp ring with (8) M14 hex headcap screws and washers (item 18 & 19). Tighten evenly around circumference. Torque the screws to 75 ft-lbs (102 N-m) unlubricated. See figure 43.
7. Using a 22mm socket, turn the (2) jackscrews (item 29) clockwise until the heads touch the motor adapter (item 12).
8. Install vapor protection o-ring (item 9) into groove of clamp ring.
9. Carefully slide the wet end towards the motor adapter until it touches the jackscrews (there will be some magnetic attraction). See figure 44.
10. Slowly and evenly turn the jackscrews counterclockwise to allow the wet end to slowly slide into the motor adapter. When the jack screws are fully retracted, lift the wet end slightly and slide it onto the motor adapter's locating flange.
11. Bolt the wet end to the motor adapter by re-installing the (4) M14 hex head cap screws and washers (item 18 & 19) and torque evenly to 75 ft-lbs (102 N-m).

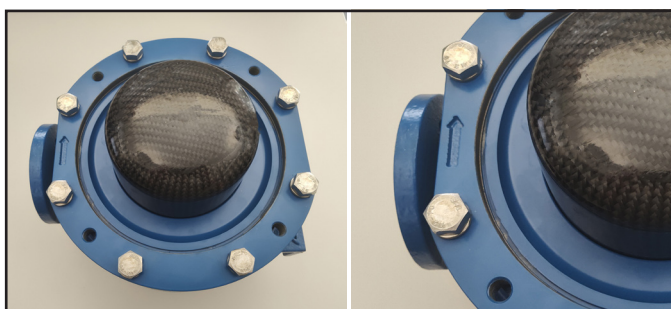


figure 43

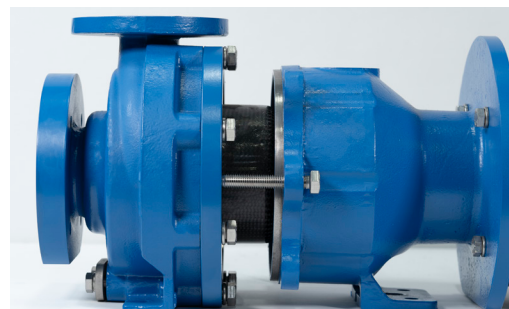


figure 44

TROUBLESHOOTING

NO OR INSUFFICIENT DISCHARGE

- Air leaks in suction piping.
- Pump not primed.
- Discharge head higher than anticipated.
- Closed valve.
- Viscosity or specific gravity too high (magnets uncoupled).
- Suction lift too high or insufficient NPSH.
- Clogged suction line or impeller vanes.
- Motor rotation incorrect (correct rotation when viewed from the fan end is clockwise).

INSUFFICIENT PRESSURE

- Air or gas in liquid.
- Impeller diameter too small.
- System head lower than anticipated.
- Motors speed insufficient (too low) or motor rotation incorrect (correct rotation when viewed from the fan end is clockwise).

LOSS OF PRIME

- Leaking suction line.
- Foot valve or suction opening not submerged enough.
- Foot valve too small or leaking.
- Air or gas in liquid.
- Foreign matter in impeller.
- Leaking valve. Suction lift too high or insufficient NPSH.

EXCESSIVE POWER CONSUMPTION

- Head lower than rating.
- Excessive flow.
- Specific gravity or viscosity too high.

VIBRATION/NOISE

- Loose magnet.
- Drive magnet rubbing.
- Pump cavitation from improper suction or feed.
- Motor or piping not properly secured.
- Foreign object in impeller.

IMPORTANT NOTICE

U.S. Export Administration Regulations, pursuant to ECCN 2B350, prohibit the export or reexport to certain enumerated countries of sealless centrifugal pumps in which all wetted materials are constructed from fluoropolymers without first applying for and obtaining a license from the U.S. Bureau of Industry and Security (BIS). This affects all Finish Thompson magnetic-drive pumps entirely constructed from PVDF or ETFE. Please contact the BIS (www.bis.doc.gov) or Finish Thompson with questions regarding the Regulations or a list of the countries to which they apply.

CHEMICAL REACTION DISCLAIMER

The user must exercise primary responsibility in selecting the product's materials of construction, which are compatible with the fluid(s) that come(s) in contact with the product. The user may consult Finish Thompson, Inc. (manufacturer) and a manufacturer's representative/distributor agent to seek a recommendation of the product's material of construction that offers the optimum available chemical compatibility.

However, neither manufacturer nor agent shall be liable for product damage or failure, injuries, or any other damage or loss arising out of a reaction, interaction or any chemical effect that occurs between the materials of the product's construction and fluids that come into contact with the product's internals.

HELPFUL HINTS

Do not pump liquids containing ferrous metal fines.

If magnets de-couple, stop the pump immediately. The rare earth magnets used in this pump are more resistant to demagnetization, but operating the pump with the magnets de-coupled will eventually weaken the magnets.

A power monitor is strongly recommended. This device will help protect the pump against abnormal operating conditions such as dry running, magnet de-coupling, cavitation, etc.

The setting of the drive magnet dimension is critical. Failure to properly set the dimension may result in de-coupling or damage to pump components.

Do not use mismatched drive magnet assemblies (impeller drive magnet and the outer drive magnet assembly). The drives are marked with either an "A" or "B". Use only components with the same drive letter designation. A serial number plate is attached to the motor adapter section.

Call our toll free Technical Service Hot Line, 1-800-888-3743, if you have any questions regarding product operation or repair.

ORDERING SPARE PARTS

Spare parts can be ordered from your local distributor. Always refer to the pump model number to avoid error.

OTHER FINISH THOMPSON PUMP PRODUCTS


Drum Transfer Pumps are available in sanitary construction, Stainless steel, polypropylene and CPVC. Flows to 40 gpm, Discharge heads to 300 feet and viscosities to 100,000 cps.

Portable Mixers for turbine mixing and blending handle viscosities to 1,000 cP with gentle, non-vortexing circulation. Available in 316 stainless steel construction.

Centrifugal Pumps in polypropylene, PVDF, stainless steel, or Hastelloy C come with a wide variety of sealing materials. Flows to 330 gpm, discharge heads to 275 feet, and temperatures to 220°F (104°C)

For more information contact Finish Thompson Inc. Call our toll free Technical Service Hot Line, 1-800-888-3743, if you have any questions regarding product operation or repair.

UCP EXPLODED VIEW PARTS DIAGRAM

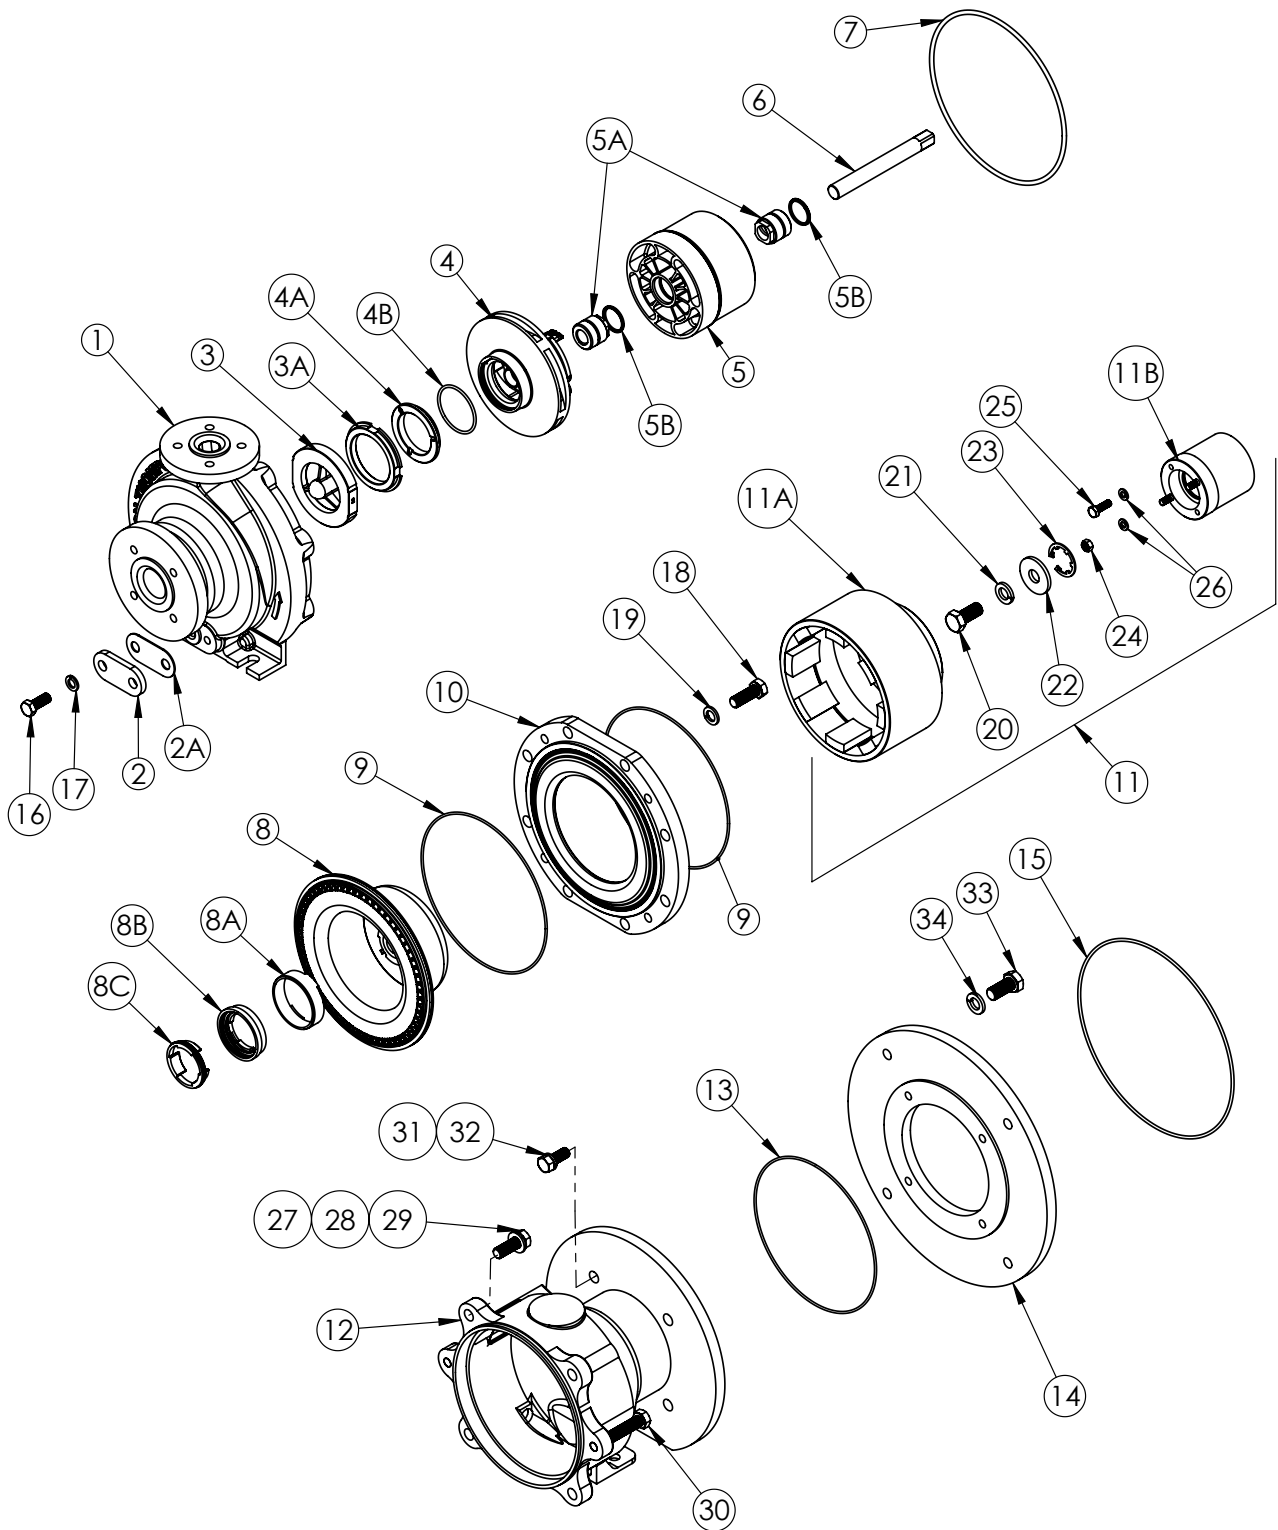

UCP Spare Parts			
Item	Qty	Description	Part Number
1	1	Casing - ETFE-lined Cast Ductile Iron	
		UCP1516 - ANSI 150# flange	210061-1
		UCP1516 - ANSI 300# flange	210061-2
		UCP1516 - ISO/DIN/PN40 flange	210061-3
		UCP1516L - ANSI 150# flange	210115-1
		UCP1516L - ANSI 300# flange	210115-2
		UCP1516L - ISO/DIN/PN40 flange	210115-3
		UCP1518 - ANSI 150# flange	210051-1
		UCP1518 - ANSI 300# flange	210051-2
		UCP1518 - ISO/DIN/PN40 flange	210051-3
		UCP1518L - ANSI 150# flange	210120-1
		UCP1518L - ANSI 300# flange	210120-2
		UCP1518L - ISO/DIN/PN40 flange	210120-3
		UCP3156 - ANSI 150# flange	210064-1
		UCP3156 - ANSI 300# flange	210064-2
		UCP3156 - ISO/DIN/PN40 flange	210064-3
		UCP326 - ANSI 150#	210070-1
		UCP326 - ANSI 300#	210070-2
		UCP326 - ISO/PN40 flange	210070-3
		UCP326H - ANSI 150#	210067-1
		UCP326H - ANSI 300#	210067-2
		UCP326H - ISO/PN40 flange	210067-3
		UCP436L - ANSI 150# flange	210128-1
		UCP436L - ANSI 300# flange	210128-2
		UCP436L - ISO/DIN/PN40 flange	210128-3
2	1	Drain Cap - 304 SS	
		Standard	212390
		For thermowell	210248
2A		Drain Cap Gasket - Gylon	
		Standard	210155
		For thermowell	210155-1
3	1	Front Shaft Support Only (3A sold separately)	
		UCP1516/1516L	210034-5
		UCP1518/1518L/3156/326/326H/436L	210034-6
3A	1	Front Thrust Ring Only	
		Silicon Carbide - all models except UCP1516/1516L	210035
		Silicon Carbide- UCP1516/1516L	210280
4	1	Impeller Assembly - Includes Item 4A & 4B (if required)	
		PP	See impeller page
4A	1	Impeller Thrust Ring	
		For UCP1516 - Glass/molybdenum filled PTFE	210486
		For UCP1518 -Glass/molybdenum filled PTFE	210488
		For UCP3156/326/326H/436L - Glass/molybdenum filled PTFE	210487
		For UCP1516/1516L - Silicon Carbide	J104172
		For UCP1518/1518L - Silicon Carbide	J104171
4B	1	Impeller Thrust Ring O-Ring - For Use With Silicon Carbide Thrust Ring Option Only	
		UCP1516/1516L - PTFE Encapsulated FKM	109327
		UCP1518/1518L/3156/326/326H/436L - PTFE Encapsulated FKM	108038

Item	Qty	Description	Part Number
5		Impeller Drive Hub	
		"B" magnet - pure ETFE	210588
5A	2	Bushings (includes bushing & bushing retainer)	
		Silicon carbide	211628-1
		Carbon	211628-2
		Silicon carbide with Dri-Coat diamond-like coating	211628-3
5B	2	Bushing Retainer	
		All Models- PTFE	210039
6	1	Shaft	
		Alumina Ceramic	J103643-2
		Silicon carbide	J103643
		Silicon carbide with Dri-Coat diamond-like coating	J103643-1
7	1	Housing O-ring	
		FKM	210041
		EPDM	210042
		Kalrez	210504
		Simriz	210503
		FEP Encapsulated FKM	210479
8	1	Barrier Assembly - Includes Item 8A, 8B, & 8C	
		All Models	210257-2
8A	1	Rear Sealing Ring	
		PTFE	210054
8B	1	Rear Sealing Ring Retainer	
		Polypropylene	210038-1
8C	1	Rear Sealing Ring Retainer Lock	
		Polypropylene	210037-2
9	2	Vapor Protection O-ring - Buna	
		For barrier/clamp ring & clamp ring/motor adapter	108585
10	1	Clamp Ring	
		Painted ductile iron	210478
11	1	Outer Drive Assembly (includes item "A & 11B)- Painted Ductile Iron/Steel	
		143-145TC "B" magnet	211823-1
		182-184TC "B" magnet	211823-2
		213-215TC "B" magnet	211823-3
		254-256TC "B" magnet	211823-4
		284-286TSC "B" magnet	211823-5
		IEC 90 "A" magnet	211823-6
		IEC 100/112 "B" magnets, B14 flange	211823-7
		IEC 100/112 "B" magnets, B5 flange	211823-8
		IEC 132 "B" magnets	211823-9
		IEC 160 "B" magnets	211823-10
11A	1	Outer Drive Magnet Hub - Painted Ductile Iron	
		"B" magnet	108432

Item	Qty	Description	Part Number
11B	1	Shaft Adapter - Painted Steel (Includes Retaining Ring & Set Screws For NEMA Frames)	
		NEMA 143-145TC	108547-1
		NEMA 182-184TC	108547-2
		NEMA 213-215TC	108547-3
		NEMA 254-256TC	108547-4
		NEMA 284-286TSC	108547-9
		IEC 90	108547-5
		IEC 100-112, B14 flange	108547-6
		IEC 100-112, B5 flange	108547-10
		IEC 132	108547-7
		IEC 160	108547-8
12	1	Motor Adapter - Painted Ductile Iron	
		NEMA 143-145TC	210591-1
		NEMA 143-145TC with non-sparking ring	210597-6
		NEMA 182-184TC, 213-215TC, 254-256TC	210592-1
		NEMA 182-184TC, 213-215TC, 254-256TC with non-sparking ring	210592-5
		NEMA 284-286TSC	210592-4
		NEMA 284-286TSC with non-sparking ring	210592-8
		IEC 90 B14	210597-2
		IEC 90 B14 w/ non-sparking ring (ATEX)	210597-7
		IEC 90 B5	210597-4
		IEC 90 B5 - w/ non-sparking ring (ATEX)	210597-9
		IEC 100-112 B14	210597-3
		IEC 100-112 B14 with non-sparking ring (ATEX)	210597-8
		IEC 100-112 B5	210592-3
		IEC 100-112 B5 with non-sparking ring (ATEX)	210592-7
		IEC 132 B5	210592-2
		IEC 132 B5 with non-sparking ring (ATEX)	210592-6
		IEC 160 B5	210592-1
		IEC 160 B5 with non-sparking ring (ATEX)	210592-5
13	1	Motor End Vapor Protection O-ring - Buna	
		NEMA 143-145TC	106549
		NEMA 182-184TC, 213-215TC, 254-256TC	108165
		NEMA 284-286TSC	108736
		IEC 90 B14	108937
		IEC 100-112 B14	108588
		IEC 132 B5	108589
14	1	Motor Adapter Flange - Painted Steel	
		IEC 160 B5 only	107968
15	1	Motor Adapter Flange Vapor Protection O-ring - Buna	
		IEC 160 B5 only	108594
**	1	Foot - Epoxy Painted Ductile Iron	
		UCR326H / 436L only	110233

Hardware - All Models			
Item	Qty	Description	Part Number
16	2	Drain Cap Hex Head Cap Screw - Stainless Steel	
		M12-1.75 x 30mm	106507
17	2	Drain Cap Lock Washer - Stainless Steel	
		M12	106503
18	8	Casing Hex Head Cap Screw - Stainless Steel	
		M14-2.0 x 40mm	210033
19	8	Casing Lock Washer - Stainless Steel	
		M14	210156
20	1	Shaft Bolt - Stainless Steel (IEC Motors Only)	
		IEC 90, IEC 100-112 - M8-1.25 x 25mm hex head cap screw	J103662
		IEC 100-112 - M10-1.5 x 35mm fillister head cap screw	108582
		IEC 132 - M12-1.75 x 30mm hex head cap screw	106507
		IEC 160 - M16-2 x 35mm hex head cap screw	108270
21	1	Shaft Lock Washer - Stainless Steel (IEC Motors Only)	
		IEC 90 - 5/16"	J102282
		IEC 100-112	N/A
		IEC 132 - M12	106503
		IEC 160 - M16	107924
22	1	Shaft Washer (IEC Motors Only) - Stainless Steel	
		IEC 90	108581-1
		IEC 100-112	108580
		IEC 132	108581-2
		IEC 160	108581-3
23	1	Retaining Ring - Steel	
		NEMA 143-145TC	105709
		NEMA 182-184TC	105710
		NEMA 213-215TC	106454
		NEMA 254-256TC	106718
		IEC 90	105712
		IEC 100-112	105710
		IEC 132	106468
		IEC 160	106714
24	2	Shaft Adapter Hex Nut - Stainless Steel	
		M8	J103930
25	2	Shaft Adapter Hex Head Cap Screw - Stainless Steel	
		M8-1.25 x 25mm	J103662
26	4	Shaft Adapter Lock Washer - Stainless Steel	
		5/16"	J102282
27	4	Motor Adapter Hex Head Cap Screw - Stainless Steel	
		M14-2.0 x 40mm	210033
28	4	Motor Adapter Lock Washer - Stainless Steel	
		M14	210156
29	4	Motor Adapter Flat Washer - Stainless Steel	
		M14	211483
30	2	Jack Screws Hex Head Cap Screw- Stainless Steel	
		M14-2.0 x 80mm	210157

Item	Qty	Description	Part Number
31	4	Motor Adapter Hex Head Cap Screw - Stainless Steel	
		NEMA 143-145TC - 3/8-16 x 1-1/4	J103118
		NEMA 182-184TC, 213-215TC, 254-256TC, 284-286TSC - 1/2-13 x 1-1/2	J101858
		IEC 90, IEC 100-112 - M8-1.25 x 25mm	J103662
		IEC 132 - M12-1.75 x 35mm	105337
		IEC 160* - 1/2-13 x 1-1/4	J103782
32	4	Motor Adapter Lock Washer - Stainless Steel	
		NEMA 143-145TC - 3/8"	J100115
		NEMA 182-184TC, 213-215TC, 254-256TC, 284-286TSC - 1/2"	J101023
		IEC 90, IEC 100-112 - 5/16"	J102282
		IEC 132 - M12	106503
		IEC 160* - 1/2"-13 x 1-1/4	J101023
33	4	Motor to Motor Adapter Flange - Stainless Steel (IEC 160/B5 Motors Only)	
		IEC 160 - M16-2.0 x 35mm	108270
34	4	Motor to Motor Adapter Flange Lockwashers - Stainless Steel (IEC 160/B5 Motors Only)	
		IEC 160 - M16	107924

*For IEC 160 pumps, these bolts (items 30 & 31) attach the motor adapter (Item 12) to supplied motor adapter flange (Item 14). Hardware to attach motor adapter to the motor adapter flange, please see items 32 and 33.

Item	Qty	Description	Part Number
**	2	Shaft Adapter Set Screw - Stainless Steel	
		3/8-16 x 5/8 knurled cup point	110112
**	2	Hex Head Cap Screw - Stainless Steel	
		3/8-16 x 1" - for UCR326H/436L foot only	J100114
**	2	Lock Washer - Stainless Steel	
		3/8" - for UCR326H/436L foot only	J100115
**	1	Outer Drive Protection Tube	
		Cardboard tube (for assembly only)	108958-1
**	1	Maintenance tool kit for UCP Series Pumps	
		Includes impeller trim arbor, impeller & bushing installation tools, and front shaft support removal tool, bushing removal tool, and rear sealing ring installation tool.	211639
**	1	UCP/UCI Single Piece Snap-fit Impeller Removal Tool	
		Includes prong release tool, 5" long bolt, bushing, & drive pin.	111428
**	1	UCP Bushing Removal Tool	
		Includes bushing removal arbor	211499
**	1	UCP Sealing Ring Retainer Lock Installation Tool	
		Includes bushing removal arbor	211197

**Items not shown.

Impeller Part Numbers

UCP1516 with Glass/Moly filled PTFE Thrust Ring	
Imp. Dia	Part Number
6 3/8"	211907
6 1/4"	211907-1
6 1/8"	211907-2
6"	211907-3
5 7/8"	211907-4
5 3/4"	211907-5
5 5/8"	211907-6
5 1/2"	211907-7
5 3/8"	211907-8
5 1/4"	211907-9
5 1/8"	211907-10
5"	211907-11
4 7/8"	211907-12
4 3/4"	211907-13
4 5/8"	211907-14
4 1/2"	211907-15
4 3/8"	211907-16
4 1/4"	211907-17
4 1/8"	211907-18
4"	211907-19

UCP1516/1516L with SiC Thrust Ring and PTFE Encapsulated O-Ring	
Imp. Dia	Part Number
6 3/8"	211909
6 1/4"	211909-1
6 1/8"	211909-2
6"	211909-3
5 7/8"	211909-4
5 3/4"	211909-5
5 5/8"	211909-6
5 1/2"	211909-7
5 3/8"	211909-8
5 1/4"	211909-9
5 1/8"	211909-10
5"	211909-11
4 7/8"	211909-12
4 3/4"	211909-13
4 5/8"	211909-14
4 1/2"	211909-15
4 3/8"	211909-16
4 1/4"	211909-17
4 1/8"	211909-18
4"	211909-19

UCP1518 with Glass/Moly filled PTFE Thrust Ring	
Imp. Dia	Part Number
8 1/4"	211902
8 1/8"	211902-1
8"	211902-2
7 7/8"	211902-3
7 3/4"	211902-4
7 5/8"	211902-5
7 1/2"	211902-6
7 3/8"	211902-7
7 1/4"	211902-8
7 1/8"	211902-9
7"	211902-10
6 7/8"	211902-11
6 3/4"	211902-12
6 5/8"	211902-13
6 1/2"	211902-14
6 3/8"	211902-15
6 1/4"	211902-16
6 1/8"	211902-17
6"	211902-18

UCP1518/UCP1518L with SiC Thrust Ring and PTFE Encapsulated O-Ring	
Imp. Dia	Part Number
8 1/4"	211905
8 1/8"	211905-1
8"	211905-2
7 7/8"	211905-3
7 3/4"	211905-4
7 5/8"	211905-5
7 1/2"	211905-6
7 3/8"	211905-7
7 1/4"	211905-8
7 1/8"	211905-9
7"	211905-10
6 7/8"	211905-11
6 3/4"	211905-12
6 5/8"	211905-13
6 1/2"	211905-14
6 3/8"	211905-15
6 1/4"	211905-16
6 1/8"	211905-17
6"	211905-18

UCP3156 with Glass/Moly filled PTFE Thrust Ring	
Imp. Dia	Part Number
6 3/8"	211899
6 1/4"	211899-1
6 1/8"	211899-2
6"	211899-3
5 7/8"	211899-4
5 3/4"	211899-5
5 5/8"	211899-6
5 1/2"	211899-7
5 3/8"	211899-8
5 1/4"	211899-9
5 1/8"	211899-10
5"	211899-11
4 7/8"	211899-12
4 3/4"	211899-13
4 5/8"	211899-14
4 1/2"	211899-15

UCP3156 with SiC Thrust Ring and PTFE Encapsulated O-Ring	
Imp. Dia	Part Number
6 3/8"	211900
6 1/4"	211900-1
6 1/8"	211900-2
6"	211900-3
5 7/8"	211900-4
5 3/4"	211900-5
5 5/8"	211900-6
5 1/2"	211900-7
5 3/8"	211900-8
5 1/4"	211900-9
5 1/8"	211900-10
5"	211900-11
4 7/8"	211900-12
4 3/4"	211900-13
4 5/8"	211900-14
4 1/2"	211900-15

"UCP326/326H/436L with Glass/Moly filled PTFE thrust ring"	
Imp. Dia	Part Number
6 3/8"	211893
6 1/4"	211893-1
6 1/8"	211893-2
6"	211893-3
5 7/8"	211893-4
5 3/4"	211893-5
5 5/8"	211893-6
5 1/2"	211893-7
5 3/8"	211893-8
5 1/4"	211893-9
5 1/8"	211893-10
5"	211893-11
4 7/8"	211893-12
4 3/4"	211893-13
4 5/8"	211893-14
4 1/2"	211893-15
4 3/8"	211893-16
4 1/4"	211893-17

UCP326/326H/436L with SiC Thrust Ring and PTFE Encapsulated O-Ring	
Imp. Dia	Part Number
6 3/8"	211894
6 1/4"	211894-1
6 1/8"	211894-2
6"	211894-3
5 7/8"	211894-4
5 3/4"	211894-5
5 5/8"	211894-6
5 1/2"	211894-7
5 3/8"	211894-8
5 1/4"	211894-9
5 1/8"	211894-10
5"	211894-11
4 7/8"	211894-12
4 3/4"	211894-13
4 5/8"	211894-14
4 1/2"	211894-15
4 3/8"	211894-16
4 1/4"	211894-17



FINISH THOMPSON INC.

921 Greengarden Road • Erie, PA 16501-1591 U.S.A.
 Ph 814-455-4478 • Fax 814-455-8518
 Email sales@finishthompson.com • www.finishthompson.com



Part Number 212184 06/18/2026